

E3T-ST□/FT□ series
Photoelectric sensor

Information for ISO13849-1 Compliance

Thank you for selecting OMRON product.

When the product is treated as ISO 13849-1 (Cat 1, PL c), please confirm the following:

Before operating the product, please read both this document and the 'Instruction Manual' included with the product together to acquire sufficient product knowledge. It is convenient to keep these documents on hand. When handling, please entrust it to a professional with specialized knowledge.

Terms and Conditions Agreement

Read and understand this catalog.

Please read and understand this catalog before purchasing the products. Please consult your OMRON representative if you have any questions or comments.

Warranties.

- (a) Exclusive Warranty. Omron's exclusive warranty is that the Products will be free from defects in materials and workmanship for a period of twelve months from the date of sale by Omron (or such other period expressed in writing by Omron). Omron disclaims all other warranties, express or implied.
- (b) Limitations. OMRON MAKES NO WARRANTY OR REPRESENTATION, EXPRESS OR IMPLIED, ABOUT NON-INFRINGEMENT, MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE OF THE PRODUCTS. BUYER ACKNOWLEDGES THAT IT ALONE HAS DETERMINED THAT THE PRODUCTS WILL SUITABLY MEET THE REQUIREMENTS OF THEIR INTENDED USE.

Omron further disclaims all warranties and responsibility of any type for claims or expenses based on infringement by the Products or otherwise of any intellectual property right. (c) Buyer Remedy. Omron's sole obligation hereunder shall be, at Omron's election, to (i) replace (in the form originally shipped with Buyer responsible for labor charges for removal or replacement thereof) the non-complying Product, (ii) repair the non-complying Product, or (iii) repay or credit Buyer an amount equal to the purchase price of the non-complying Product; provided that in no event shall Omron be responsible for warranty, repair, indemnity or any other claims or expenses regarding the Products unless Omron's analysis confirms that the Products were properly handled, stored, installed and maintained and not subject to contamination, abuse, misuse or inappropriate modification. Return of any Products by Buyer must be approved in writing by Omron before shipment. Omron Companies shall not be liable for the suitability or unsuitability or the results from the use of Products in combination with any electrical or electronic components, circuits, system assemblies or any other materials or substances or environments. Any advice, recommendations or information given orally or in writing, are not to be construed as an amendment or addition to the above warranty.

See <http://www.omron.com/global/> or contact your Omron representative for published information.

Limitation on Liability; Etc.

OMRON COMPANIES SHALL NOT BE LIABLE FOR SPECIAL, INDIRECT, INCIDENTAL, OR CONSEQUENTIAL DAMAGES, LOSS OF PROFITS OR PRODUCTION OR COMMERCIAL LOSS IN ANY WAY CONNECTED WITH THE PRODUCTS, WHETHER SUCH CLAIM IS BASED IN CONTRACT, WARRANTY, NEGLIGENCE OR STRICT LIABILITY.

Further, in no event shall liability of Omron Companies exceed the individual price of the Product on which liability is asserted.

Suitability of Use.

Omron Companies shall not be responsible for conformity with any standards, codes or regulations which apply to the combination of the Product in the Buyer's application or use of the Product. At Buyer's request, Omron will provide applicable third party certification documents identifying ratings and limitations of use which apply to the Product. This information by itself is not sufficient for a complete determination of the suitability of the Product in combination with the end product, machine, system, or other application or use. Buyer shall be solely responsible for determining appropriateness of the particular Product with respect to Buyer's application, product or system. Buyer shall take application responsibility in all cases.

NEVER USE THE PRODUCT FOR AN APPLICATION INVOLVING SERIOUS RISK TO LIFE OR PROPERTY OR IN LARGE QUANTITIES WITHOUT ENSURING THAT THE SYSTEM AS A WHOLE HAS BEEN DESIGNED TO ADDRESS THE RISKS, AND THAT THE OMRON PRODUCT(S) IS PROPERLY RATED AND INSTALLED FOR THE INTENDED USE WITHIN THE OVERALL EQUIPMENT OR SYSTEM.

Programmable Products.

Omron Companies shall not be responsible for the user's programming of a programmable Product, or any consequence thereof.

Performance Data.

Data presented in Omron Company websites, catalogs and other materials is provided as a guide for the user in determining suitability and does not constitute a warranty. It may represent the result of Omron's test conditions, and the user must correlate it to actual application requirements. Actual performance is subject to the Omron's Warranty and Limitations of Liability.

Change in Specifications.

Product specifications and accessories may be changed at any time based on improvements and other reasons. It is our practice to change part numbers when published ratings or features are changed, or when significant construction changes are made. However, some specifications of the Product may be changed without any notice. When in doubt, special part numbers may be assigned to fix or establish key specifications for your application. Please consult with your Omron's representative at any time to confirm actual specifications of purchased Product.

Errors and Omissions.

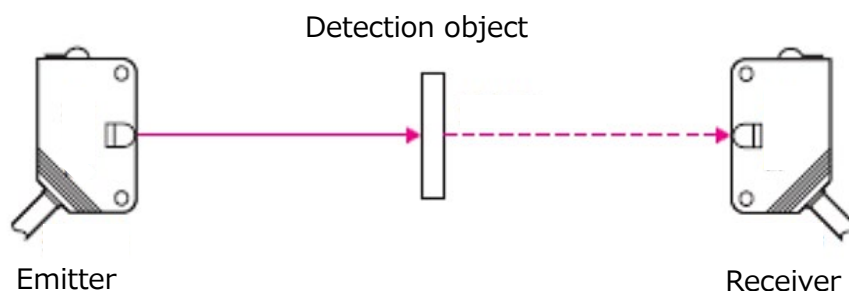
Information presented by Omron Companies has been checked and is believed to be accurate; however, no responsibility is assumed for clerical, typographical or proofreading errors or omissions.



Table of contents

1 . Product function.....	5
1.1 Timing chart	6
1.2 Control output/ Operation mode.....	7
1.3 Dimensions.....	8
1.4 Mounting distance	9
2 . Safety Precautions	11
2.1 Warning	12
2.2 Precautions for Safe Use.....	12
2.3 Precautions for Correct Use.....	13
3 . Information of standards.....	15
3.1 Compliant Standards	15
3.2 Certification Standards	15
3.3 Safety states.....	15
3.4 Safety-related parameters.....	15
3.5 Environment conditions.....	15
4 . Maintenance Checklist.....	16
4.1 Daily Inspection Checklist	16
4.2 Regular Inspection Checklist	16
4.3 Checklist for Product Replacement.....	16
5 . Troubleshooting	17
6 . Revision History	18

1. Product function

E3T-ST□/FT□ series is “Through-beam photoelectric sensor which detects objects that either reflect or interrupt visible or invisible light. The control output is a semiconductor switching element.




Sensing method		Through-beam									
Appearance		Rectangular type(Side-view)						Rectangular type(Flat)			
											
Item											
NPN output	Light-ON	E3T-ST31	E3T-ST31F	E3T-ST11(M)	E3T-ST11(M)F	E3T-ST21(M)	E3T-ST21(M)F	E3T-FT11	E3T-FT11F	E3T-FT21	E3T-FT21F
	Dark-ON	E3T-ST32	E3T-ST32F	E3T-ST12(M)	E3T-ST12(M)F	E3T-ST22(M)	E3T-ST22(M)F	E3T-FT12	E3T-FT12F	E3T-FT22	E3T-FT22F
PNP output	Light-ON	E3T-ST33	E3T-ST33F	E3T-ST13(M)	E3T-ST13(M)F	E3T-ST23(M)	E3T-ST23(M)F	E3T-FT13	E3T-FT13F	E3T-FT23	E3T-FT23F
	Dark-ON	E3T-ST34	E3T-ST34F	E3T-ST14(M)	E3T-ST14(M)F	E3T-ST24(M)	E3T-ST24(M)F	E3T-FT14	E3T-FT14F	E3T-FT24	E3T-FT24F
Sensing distance		2m		1m		300mm		500 mm		300 mm	
Standard sensing object		Opaque, 3-mm dia. min.		Opaque, 2-mm dia. min.				Opaque, 1.3-mm dia. min.			
Light source (wavelength)		Red LED (650 nm)	Infrared LED (860 nm)	Red LED (650 nm)	Infrared LED (860 nm)	Red LED (650 nm)	Infrared LED (860 nm)	Red LED (650 nm)	Infrared LED (860 nm)	Red LED (650 nm)	Infrared LED (860 nm)
Response time		Operate or reset: 1 ms max.									
Power supply voltage		12VDC -10% to 24VDC +10%, ripple (p-p) 10% max.									
Control output		Load power supply voltage: 26.4 VDC max. Load current: 50 mA max. (residual voltage: 2 V max. for load current of 10 to 50 mA, 1 V max. for load current of less than 10 mA) Open-collector output									
Dielectric strength		AC1,000V 50/60Hz 1min									
impulse withstand voltage		±1kV									
Current consumption		30 mA max. (Emitter 10 mA max., Receiver 20 mA max.)									
Degree of protection * 1		ISO13849-1 IP54						ISO13849-1 IP67			
Indicators		Operation indicator (orange), Stability indicator (green)									

* 1 When compliant with IEC60529, the E3T-ST□/FT□ series is rated as IP67.


For ratings and specifications other than those described in this document, please refer to the catalog or Instruction Manual.

1.1 Timing chart

The light-operated and dark-operated timing charts are shown in Figure.

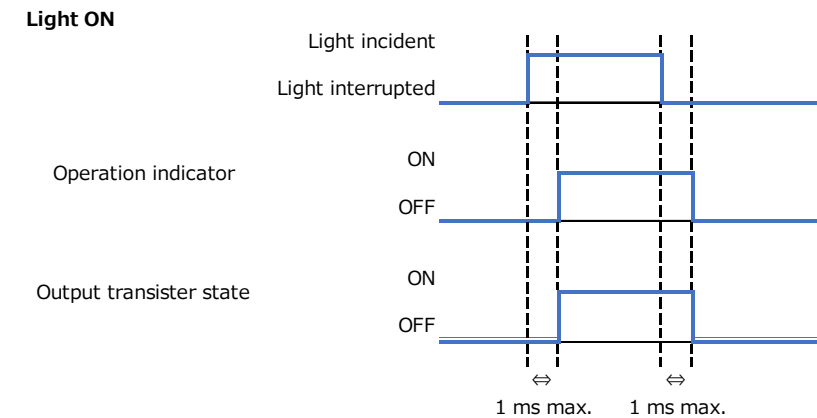

Light-operated




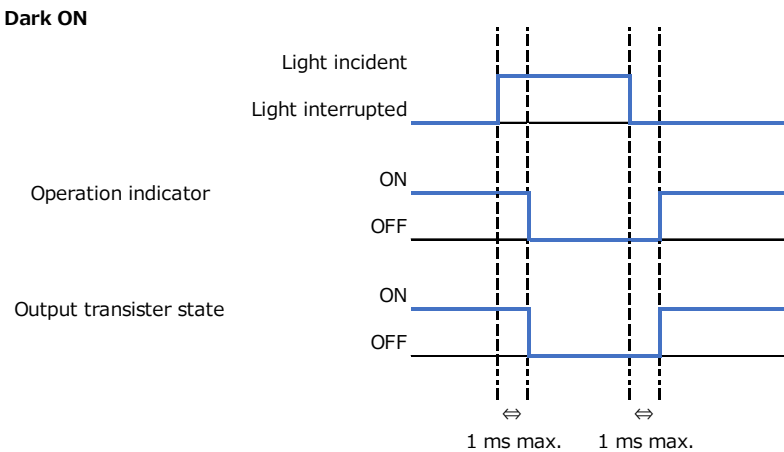


Dark-operated





1.2 Control output/ Operation mode

Control output is 2 type which is NPN output and PNP output. The operating mode, time chart, and output circuit are shown in the figure below.

NPN Output

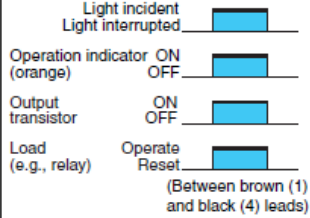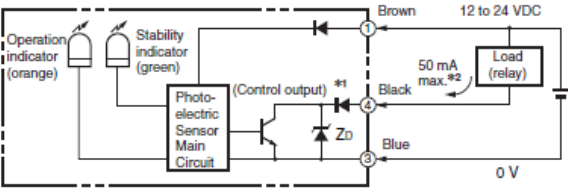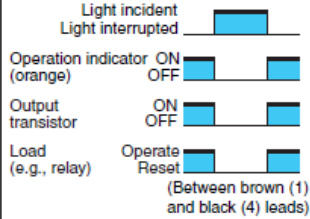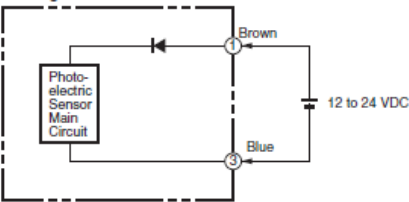Model	Operation mode	Timing charts	Output circuit
E3T-□□□1(F) E3T-□□□1M(F)	Light-ON		
E3T-□□□2(F) E3T-□□□2M(F) E3T-□□□2S	Dark-ON		 <p>*1. There is no diode for Small Cylindrical Sensors (E3T-C□□□(S)). *2. This is 80 mA max. for Small Cylindrical Sensors (E3T-C□□□(S)).</p>

PNP Output

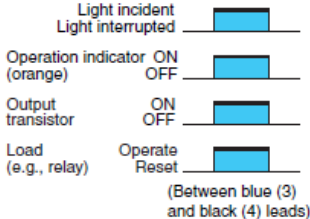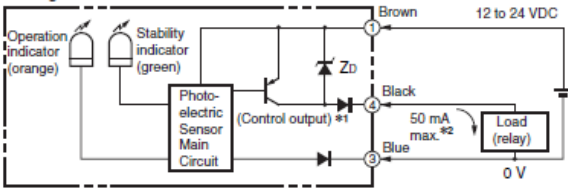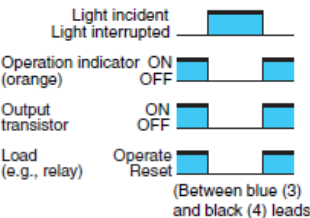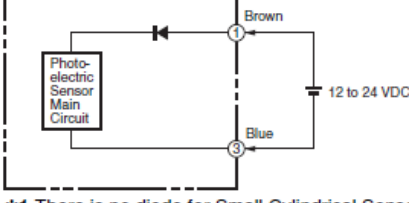Model	Operation mode	Timing charts	Output circuit
E3T-□□□3(F) E3T-□□□3M(F)	Light-ON		
E3T-□□□4(F) E3T-□□□4M(F) E3T-□□□4S	Dark-ON		 <p>*1. There is no diode for Small Cylindrical Sensors (E3T-C□□□(S)). *2. This is 80 mA max. for Small Cylindrical Sensors (E3T-C□□□(S)).</p>

The conditions under which the control output is turned on are different.

Operation mode	Output of Light-ON	Output of Dark-ON
Detection Object (Light interrupted)	OFF	ON
No detected object (Light incident)	ON	OFF

1.3 Dimensions


M2-mounting Sensors

Through-beam Side-view Sensors

- E3T-ST1□(F) (Emitter)
- E3T-ST2□(F) (Emitter)
- E3T-ST3□(F) (Emitter)




Emitter: E3T-ST□□(F)-L
Receiver: E3T-ST□□(F)-D

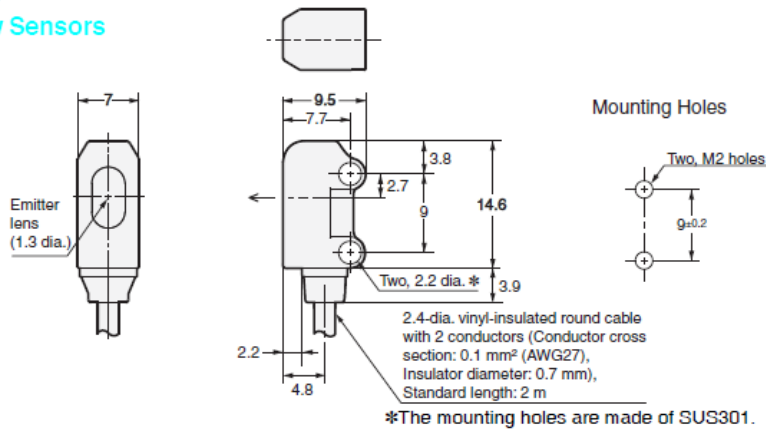

- E3T-ST1□(F) (Receiver)
- E3T-ST2□(F) (Receiver)
- E3T-ST3□(F) (Receiver)

*The receiver lens diameters are given below.

Model	Receiver lens diameter
E3T-ST1□-D E3T-ST2□-D	(1.3 dia.)
E3T-ST3□-D	(2.4 dia.)

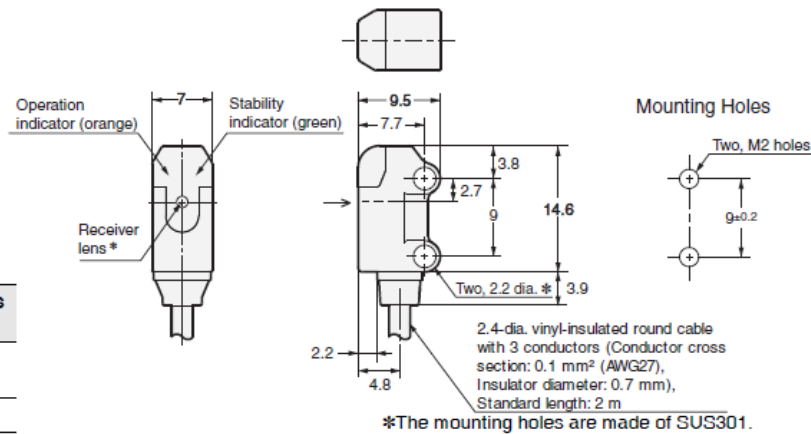


Through-beam Flat Sensors


- E3T-FT1□(F) (Emitter)
- E3T-FT2□(F) (Emitter)



Emitter: E3T-FT□□(F)-L
Receiver: E3T-FT□□(F)-D

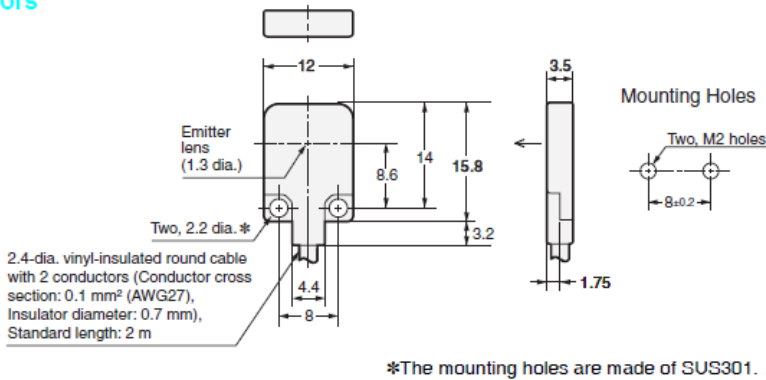

- E3T-FT1□(F) (Receiver)
- E3T-FT2□(F) (Receiver)

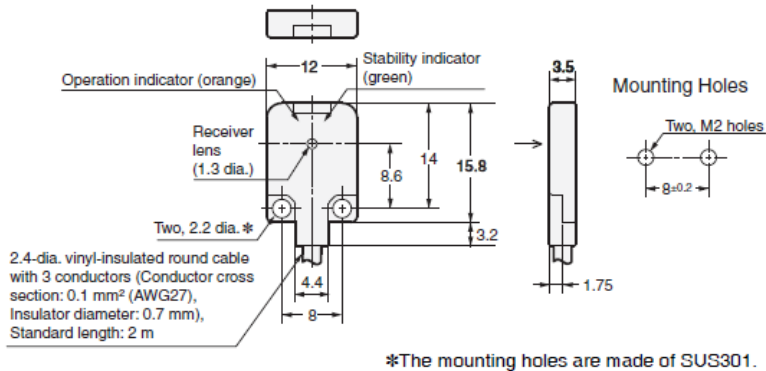

1.4 Mounting distance

⚠ WARNING

Do not use the sensor system with mirrors in a retro-reflective configuration.



When using more than 1 set of E3T-ST□/FT□ in adjacent areas, the emitter of one E3T-ST□/FT□ may interfere with the receiver of the other, causing the safety functions to stop working properly.




Install and configure them so that mutual interference does not occur.


If using more than one sensor, which need to leave space given 1.5x in the following figure. When installing reflective objects around it as well, which need to leave space given 1.5x.

Using with mounted slit E39-S63/S64 is not scope of ISO13849-1(PL c,Cat1).


Red LED

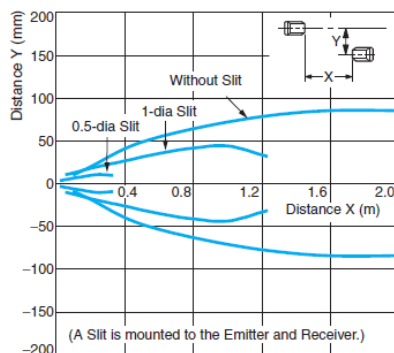


E3T-ST1□(M)+E39-S63

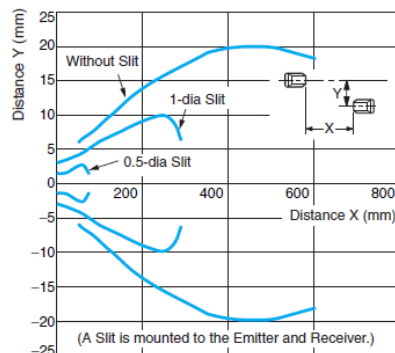


E3T-ST2□(M)+E39-S63

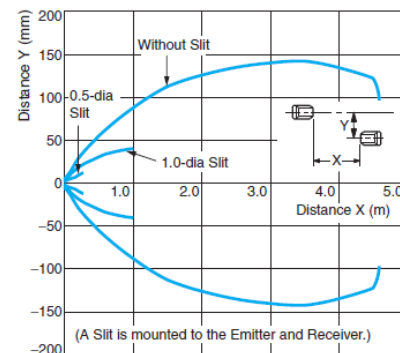

E3T-ST3□+E39-S63

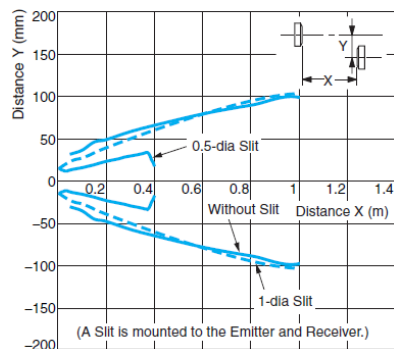


E3T-FT1□+E39-S64

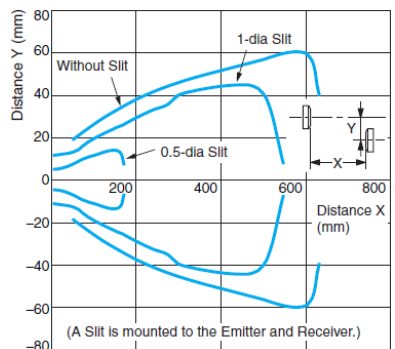


E3T-FT2□+E39-S64


Infrared LED

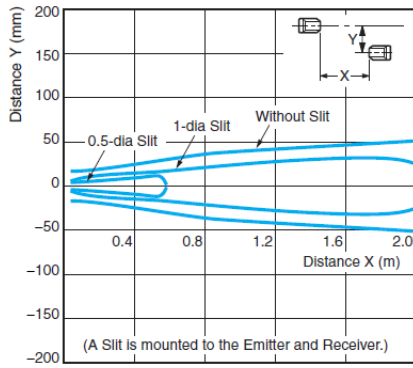


E3T-ST1 □ (M) F+E39-S63

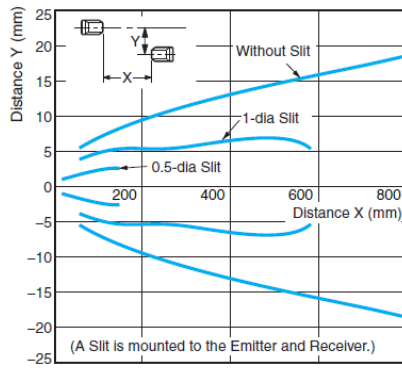


E3TT-ST2 □ (M) F+E39-S63

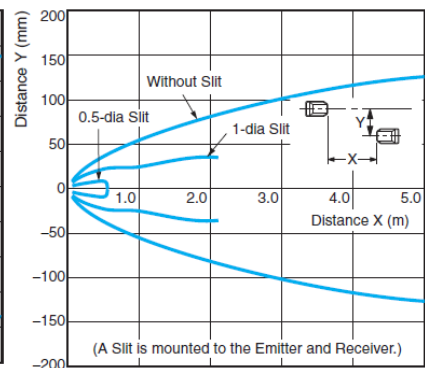

E3T-ST3 □ (M) F+E39-S63

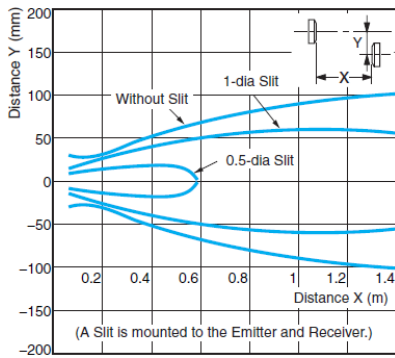

E3T-FT1 □ F+E39-S64

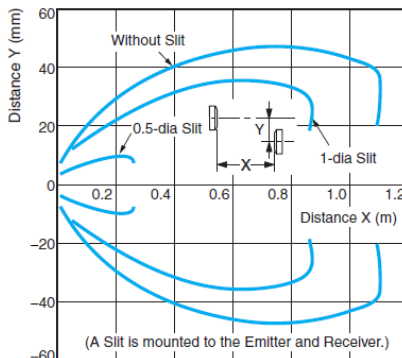


E3T-FT2 □ F+E39-S64





2. Safety Precautions

The E3T-ST□ and E3T-FT□ series conforms to the international standard ISO 13849-1 (Cat 1, PL c). Before operating the product, please read both this document and the 'Instruction Manual' included with the product together to acquire sufficient product knowledge.






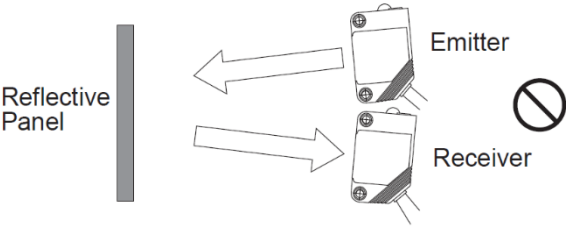




The following notation is used in this manual to provide precautions required to ensure safe usage of a E3T-ST□ and E3T-FT□ series.

 WARNING	Indicates a potentially hazardous situation which, if not avoided, will result in minor or moderate injury, or may result in serious injury or death. Additionally there may be significant property damage.
Precautions for Safe Use	Indicates precautions on what to do and what not to do to ensure using the product safely.
Precautions for Correct Use	Indicates precautions on what to do and what not to do to ensure proper operation and performance.

The symbols have the following meanings:

	Indicates prohibited actions.
	Indicates mandatory actions.
	Indicates the risk of electric shock
	Indicates the risk of rupture.

2.1 Warning


<div> WARNING</div>	
Do not connect the E3T to an AC or DC power supply with higher voltage than nominal DC24V. Otherwise the sensor may explode, burn, or cause electric shock.	 
<div>This product is not designed to be used either directly in applications that detect human presence for the purpose of maintaining safety. Do not use this product in sensing devices designed to be provide directly human safety.</div>	
Use an opaque test rod with 3mm in diameter. The E3T cannot detect transparent materials.	
Do not use the E3T in a reflective configuration, otherwise detection may fail. <div></div>	
Do not install the E3T in a location where it can be affected by wall reflections to avoid detection failure, which may result in serious injury.	
When using multiple sets of E3T, arrange them to prevent mutual interference. Failure to do so may cause the sensor not to detect, resulting in serious injury.	
Wiring must be done while the power is turned OFF. Doing it with the power ON may cause an electric shock.	

2.2 Precautions for Safe Use

Precautions for Safe Use
Be sure to follow the safety precautions below for added safety. (1) Do not use the sensor under the environment with explosive or ignition gas. (2) Never disassemble, repair nor tamper with the product. (3) Do not apply voltage more than the rated voltage. (4) Do not use the sensor over the rated values. (5) When you discard the product, please process industrial waste.

2.3 Precautions for Correct Use

Precautions for Correct Use										
Do not use the product in atmospheres or environments that exceed product ratings.										
Wiring	<p>The maximum power supply voltage is 26.4 VDC. Before turning the power ON, make sure that the power supply voltage is not more than maximum voltage.</p> <p>Load short-circuit protection</p> <p>The E3T incorporates a load short-circuit protection function. If the load short-circuits, the output of the E3T will be turned OFF. Then, recheck the wiring and turn on the E3T again to reset the load short- circuit protection function. The load short-circuit protection function will work if there is a current flow that is 1.5 times larger than the rated load current. When using a capacitance load, be sure that the inrush current will not exceed 1.5 times larger than the rated current.</p>									
Mounting	<p>When mounting the Sensor, never strike it with a heavy object, such as a hammer. Doing so may reduce its watertight properties. Use screws with spring, flat, or toothed washers to secure the Sensor. Tightening Torque</p> <p>M2-mounting Sensors: 0.15 N·m max M3-mounting Sensors: 0.5 N·m max Small Cylindrical Sensors: 1 N·m max</p> <p>【Attachment to Moving Parts】</p> <p>To mount the Photoelectric Sensor to a moving part, such as a robot hand, consider using a Sensor that uses a bending-resistant cable (robot cable).</p>									
Adjusting	<p>Indicators</p> <ul style="list-style-type: none">• The following graphs indicate the status of each operating level.• Be sure to use the E3T within the stable operating range. <div><div><div>Stable operation range*</div><div>Unstable operation range*</div><div>Stable operation range*</div></div><div><div>Operating level x 1.2</div><div>Operating level</div><div>Operating level x 0.8</div></div><div><div>Stability indicator (green)</div><div>Operation indicator (orange)</div><div>E3T-□□□1 E3T-□□□3</div><div>E3T-□□□2 E3T-□□□4</div></div><table><tr><td>ON</td><td>ON</td><td>OFF</td></tr><tr><td>OFF</td><td></td><td></td></tr><tr><td>ON</td><td>OFF</td><td>ON</td></tr></table></div> <p>* If the E3T's operating level is set to the stable operation range, the E3T will be in most reliable operation without being influenced by temperature change, voltage fluctuation, dust, or setting change. If the operating level cannot be set to the stable operation range, pay attention to environmental changes while operating the E3T.</p>	ON	ON	OFF	OFF			ON	OFF	ON
ON	ON	OFF								
OFF										
ON	OFF	ON								

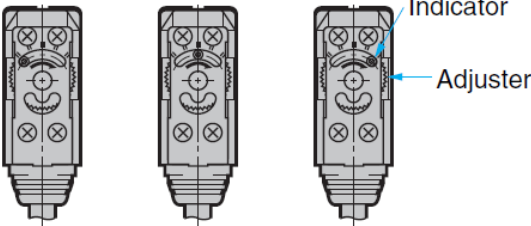	<p>Use of E39-E10 Sensitivity Adjustment Unit (Dark-ON: E3T-ST12)</p> <p>(At Min.) (At Center) (At Max.)</p>  <p>Indicator Adjuster</p> <ol style="list-style-type: none">1. Mount the Unit on the Receiver.2. Set the adjuster of the Sensitivity Adjustment Unit to Max. (Before shipping: Max.)3. After mounting on the Sensor, adjust the optical axis and secure the Sensor.4. Place a workpiece between the Emitter and Receiver and gradually turn the adjuster counterclockwise toward the Min. side. Stop turning the adjuster when the operation indicator and stability indicator (green) turn ON.5. Remove the workpiece and confirm that the operation indicator is OFF and the stability indicator (green) is ON. This completes the adjustment.
●Others	<p>Do not use the product under the following conditions.</p> <ul style="list-style-type: none">• In the place exposed to the direct sunlight.• In the place where humidity is high and condensation may occur.• In the place where corrosive gas exists.• In the place where vibration or shock is directly transmitted to the product.

3. Information of standards

E3T-ST□/FT□ series applies with the following standards.

3.1 Compliant Standards

- EMC: IEC60947-5-2:2019
- Low Voltage: IEC60947-5-2:2019

3.2 Certification Standards

TUV: ISO13849-1:2023(Cat 1, PL c),IEC60947-5-2:2019

3.3 Safety states

In case of E3T-ST/FT failure, safety state is Output transistor OFF.

3.4 Safety-related parameters

Parameter	E3T-ST□/FT□
Output short-circuit protection	Yes
MTTF _d	100 years max.
PFH _d [1/h]	2.91×10^{-7}
DC _{avg}	0
T _M	20years
Response time	1ms max.

3.5 Environment conditions

Parameter	E3T-ST□/FT□
Ambient temperature	Operation: -25 to +55 °C, Storage: -40 to +70 °C (with no condensing environment)
Ambient humidity	Operation: 35 to 85 % RH, Storage: 35 to 95 % RH (with no condensing environment)
Ambient illuminance	Incandescent light: 5,000 lx or less at the light-receiving face Sun light: 10,000 lx or less at the light-receiving face
Altitude	2000m max.
Pollution degree	3

4. Maintenance Checklist

WARNING

Please perform daily and periodic inspections for all E3T-ST□/FT□ units. Operating this device without performing the inspection or without removing the abnormal condition may cause death or serious injury.

4.1 Daily Inspection Checklist

Control output shall operate as follows:

- ☐ (Light-On Type) Output is ON when light is interrupted or OFF when light is incident.
- ☐ (Dark-On Type) Output is OFF when light is interrupted and ON when light is incident.

The operation indicator light shall exhibit the following behavior:

- ☐ (Light-On Type): The indicator light turns ON when light is incident (control output ON) and turns off when light is interrupted (control output OFF).
- ☐ (Dark-On Type): The indicator light turns OFF when light is incident (control output OFF) and turns off when light is interrupted (control output ON).
- ☐ Do not install equipment that generates external light disturbance, reflected light in the surroundings.
- ☐ Safety equipment, such as safety covers, is not damaged.

4.2 Regular Inspection Checklist

- ☐ Wiring from this product is correct.
- ☐ There is no looseness in the screws related to this product, and connectors are not disconnected.
- ☐ The detection surface (lens) of the product is not dirty.

4.3 Checklist for Product Replacement

Control output shall operate as follows:

- ☐ (Light-On Type) Output is ON when light is interrupted or OFF when light is incident.
- ☐ (Dark-On Type) Output is OFF when light is interrupted and ON when light is incident.

The operation indicator light shall exhibit the following behavior:

- ☐ (Light-On Type): The indicator light turns ON when light is incident (control output ON) and turns off when light is interrupted (control output OFF).
- ☐ (Dark-On Type): The indicator light turns OFF when light is incident (control output OFF) and turns off when light is interrupted (control output ON).
- ☐ Wiring from this product is correct.
- ☐ There is no looseness in the screws related to this product, and connectors are not disconnected.
- ☐ For installation, please refer to "1.2 Dimensions" and "1.3 Mounting distance".

*Please confirm the inspection frequency for the entire application based on your own risk assessment.

* If any abnormalities are found during the inspection, please refer to "5.Troubleshooting".

5. Troubleshooting

If the product is not operating or if there are abnormalities such as the output not switching ON/OFF, please take the following measures.

Unit	Trouble Contents	Cause and measures
Emitter	Emitter is not emitting red light. (Red LED) The power indicator light (red) is not lighting up. (Infrared LED)	There may be no power supply voltage. Please supply DC12~24V to the power supply voltage.
		There may be a wiring error. Please refer to the output circuit diagram for '1.1 Control output/Operating mode' and ensure correct wiring.
		If the above measures do not restore operation, there may be a product malfunction. We recommend replacing the product.
Receiver	Both the orange and green indicator lights are not illuminated.	There may be no power supply voltage. Please supply DC12~24V to the power supply voltage.
		There may be a wiring error. Please refer to the output circuit diagram for '1.1 Control output/Operating mode' and ensure correct wiring.
		If the above measures do not restore operation, there may be a product malfunction. We recommend replacing the product.
	The control output is not switching ON/OFF.	There may be a short circuit with other signal lines to the control output. Please ensure the control output is correctly wired.
		There is a possibility that the lens surfaces of the projector and receiver are dirty. Please check the lens surfaces and keep them clean.
		There is a possibility that the optical axes of the projector and receiver are misaligned. Please check the mounting condition and ensure correct installation.
		The load may be short-circuited, and the load short-circuit protection function may be activated. Please check the condition of the load and ensure correct wiring.
		The load current may exceed the rated value, and it is possible that the load short-circuit protection function is working properly. Please check the load you are using.
		If the above measures do not restore operation, there may be a product malfunction. We recommend replacing the product.

6 . Revision History

Revision symbol	Revision date	Revisions
01	April, 2024	First release
02	December, 2025	Correction of errors (Chapter 2.1)

OMRON Corporation Industrial Automation Company

Kyoto, JAPAN

Contact : www.ia.omron.com

Regional Headquarters

OMRON EUROPE B.V.

Wegalaan 67-69, 2132 JD Hoofddorp
The Netherlands
Tel: (31) 2356-81-300 Fax: (31) 2356-81-388

OMRON ASIA PACIFIC PTE. LTD.

438B Alexandra Road, #08-01/02 Alexandra
Technopark, Singapore 119968
Tel: (65) 6835-3011 Fax: (65) 6835-3011

OMRON ELECTRONICS LLC

2895 Greenspoint Parkway, Suite 200
Hoffman Estates, IL 60169 U.S.A.
Tel: (1) 847-843-7900 Fax: (1) 847-843-7787

OMRON (CHINA) CO., LTD.

Room 2211, Bank of China Tower,
200 Yin Cheng Zhong Road,
PuDong New Area, Shanghai, 200120, China
Tel: (86) 21-6023-0333 Fax: (86) 21-5037-2388

Authorized Distributor:

©OMRON Corporation 2023-2025 All Rights Reserved.
In the interest of product improvement,
specifications are subject to change without notice.

Cat. No. **Z484-E1-02** 1225 (1023)